



Since 01/01/2022 new hermetically sealed systems & multi-compressor centralised systems with 40kW or greater cooling capacity, selling products to end users in retail and food service applications must use refrigerants <150 GWP

**VERY LOW**  
GWP below 150

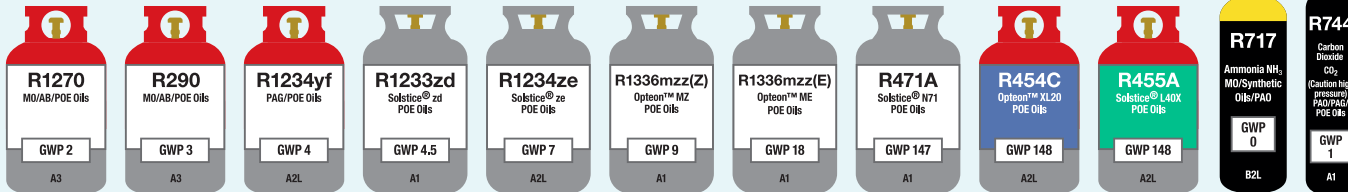

**LOW**  
GWP between 150-750

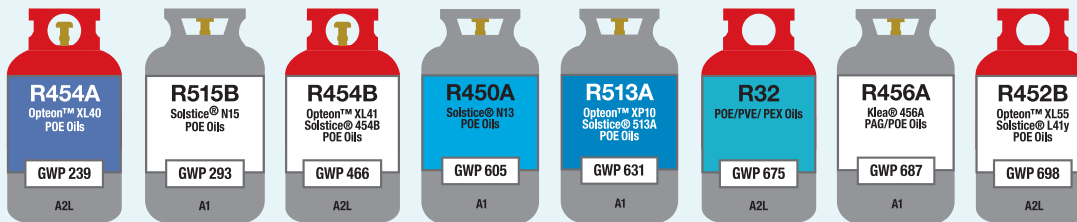

Scan to view our product portfolio

### A2L Charge Calculator

This free web based app will allow you to calculate the refrigerant charge compliant for a project, incorporating 36 commonly found refrigerants, including A2Ls.



Available at  
[a2l.climalife.com](http://a2l.climalife.com)

[climalife.co.uk](http://climalife.co.uk)

FIND US ON:




IDS Refrigeration Ltd, 22 Apex Court, Woodlands, Bradley Stoke, Bristol, BS32 4JT. 0117 980 2520.

[climalife.co.uk](http://climalife.co.uk) | [climalife.com](http://climalife.com)


**GWP**

Greater than 751

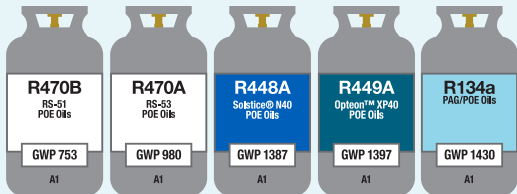

**GWP**


Greater than 1501

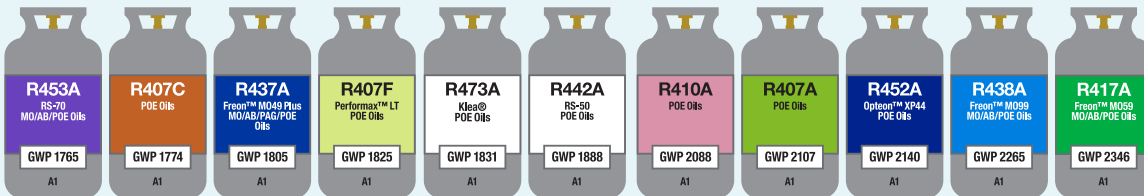

Virgin product with GWP ≥2500 has been banned in stationary refrigeration applications >40 CO<sub>2</sub> T eq since 01/01/2020. (R-508B and R-23 are exempt from ban if used below -50°C.) The use of reclaimed refrigerants with GWP ≥ 2500 is allowed until 31/12/2029 however will be subject to product availability.

**VERY HIGH**

GWP 2500 or above

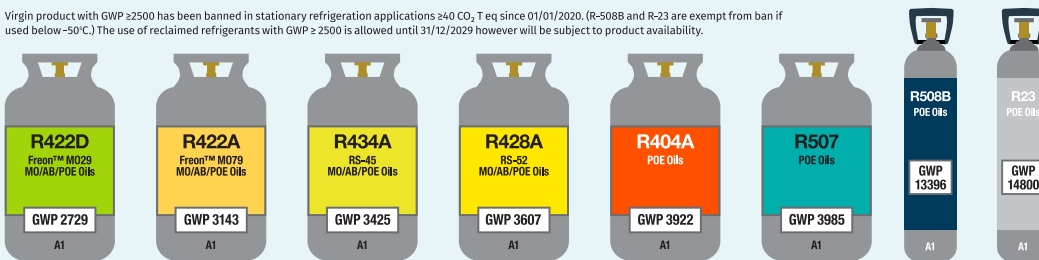

## Other Products & Services

- Nitrogen
- Cleaning
- Lubricants
- Electronic Controls
- Heat Transfer Fluids
- Reclamation & Disposal Services
- System Evaluation
- Trace Gas

IDS Refrigeration Ltd, 22 Apex Court, Woodlands, Bradley Stoke, Bristol, BS32 4JT. 0117 980 2520.

[climalife.co.uk](http://climalife.co.uk) | [climalife.com](http://climalife.com)