




VERY LOW GWP <150

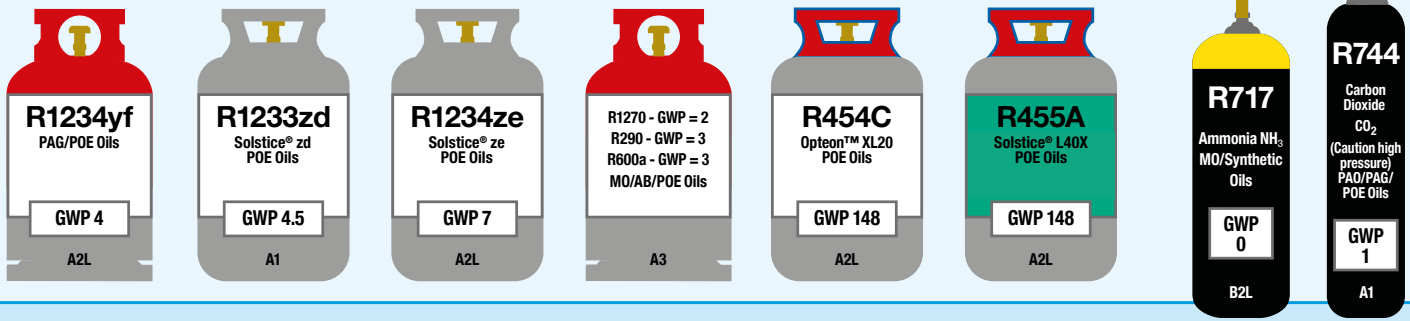


LOW GWP 150-750

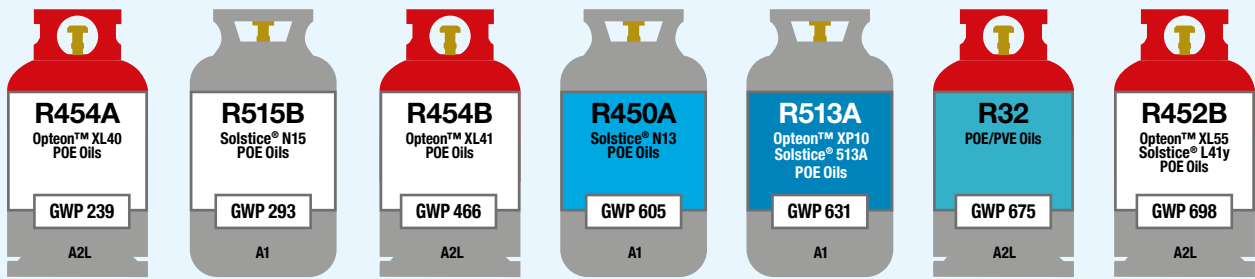


MEDIUM GWP 751-1500

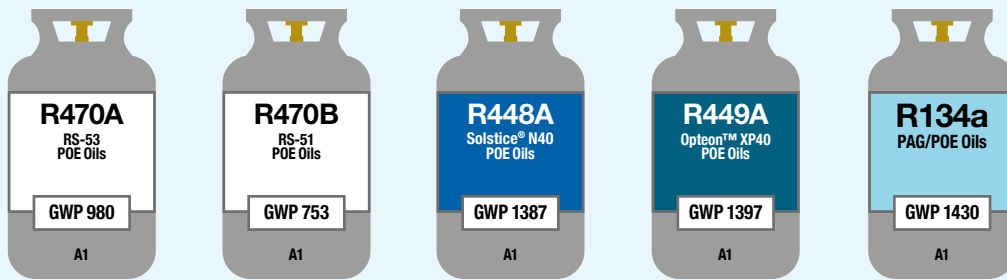

HIGH GWP 1501-2500

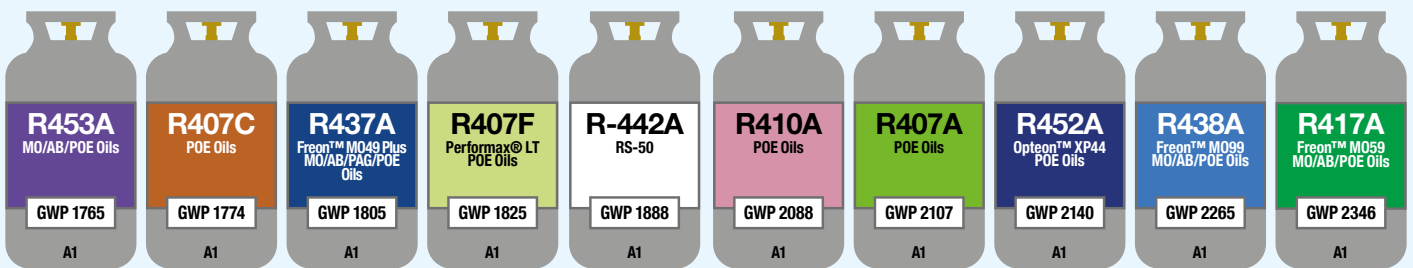

VERY HIGH GWP >2500 VIRGIN BANNED (01/01/2020) in stationary refrigeration applications > 40 CO₂ T eq. (R-508B and R-23 are exempt from ban if used below -50C.)

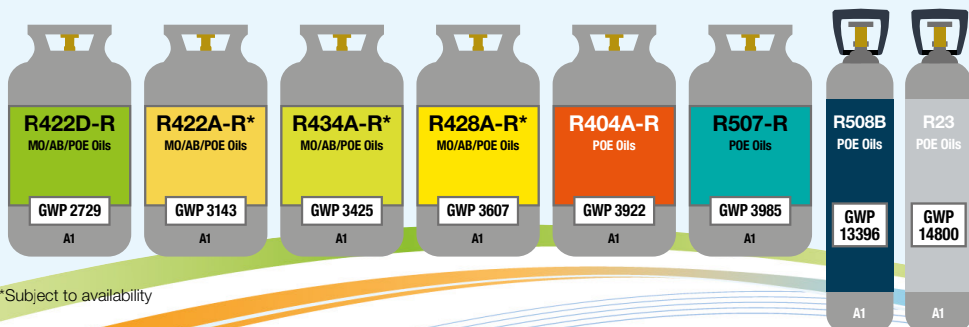

Need help choosing the right refrigerant to comply with F-Gas regulation EU 517/2014?

...download our FREE F-Gas Solutions Mobile App!



*Subject to availability

IDS Refrigeration Limited, 22 Apex Court
Woodlands, Bradley Stoke, Bristol BS32 4JT

0117 980 2520

www.climalife.co.uk / www.climalife.dehon.com

Please note: These refrigerants should only be handled by qualified personnel who comply with current legislation. There are other refrigerants not listed that have Ashrae numbers but may not be readily or commercially available. This information is intended only as a guide, please contact Climalife for more specific product information. GWP values are those stated according to the 4th IPCC assessment and EU 517/2014. When calculating CO₂ Tonnes eq for compliance with F-Gas Regulation, only use AR4 values.